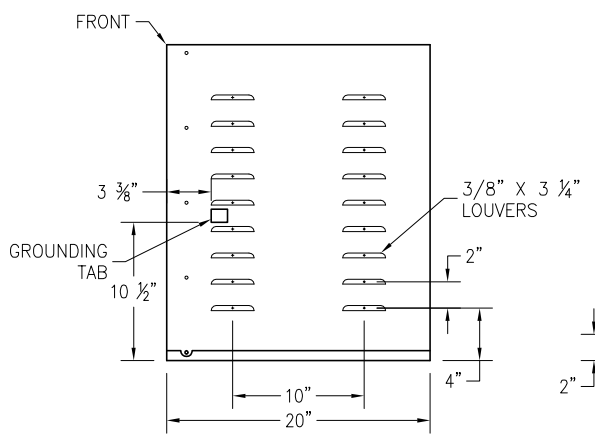

SIDE VIEW
DOOR REMOVED

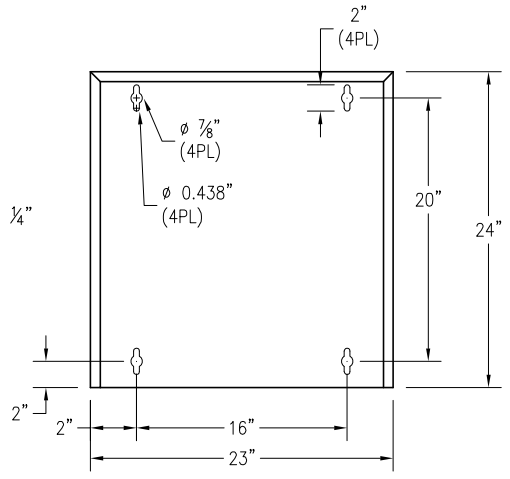

REAR VIEW

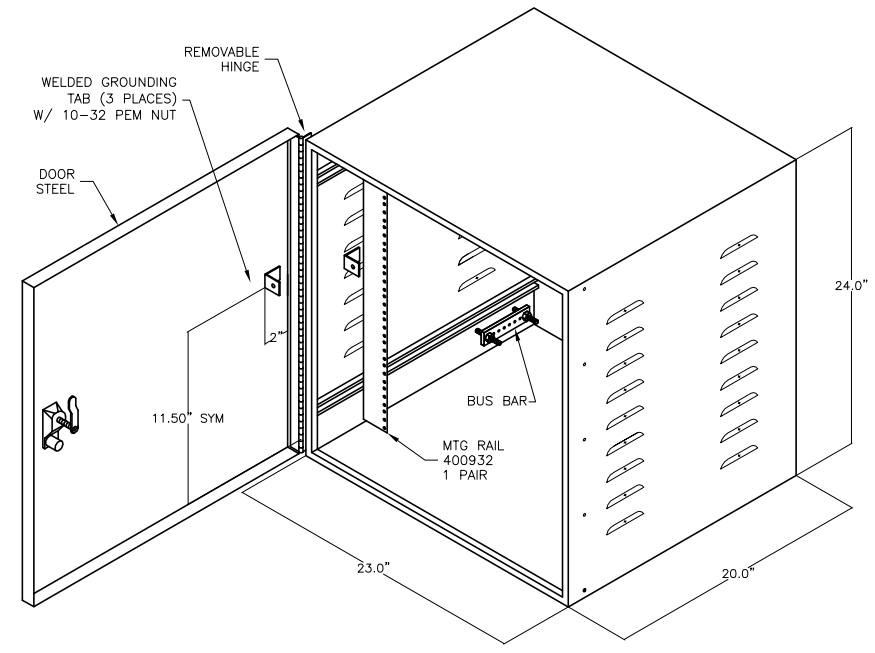

NOTES:
1. MAT'L = DOOR AND BOX – 18GA CRS
2. MAT'L = MOUNTING RAILS – 14GA CRS

4 ES.5 TYPICAL CONCENTRATOR ENCLOSURE

SCALE: NTS

NOTE:
1. CONCENTRATOR CABINET SHALL BE SOUTHWEST DATA PRODUCTS MODEL #SWDP-CWS (23"WX20"DX24"H) SUB-D BOX OR HOFFMAN ENGINEERING COMPANY EQUIVALENT MODEL #183VUREF (23"WX20"DX24"H)

2. MATERIAL = DOOR AND BOX – 18GA CRS, MOUNTING RAILS – 14GA CRS

CHICAGO PUBLIC SCHOOLS
CAPITAL IMPROVEMENT PROGRAM
INFORMATION TECHNOLOGY SERVICES
INFRASTRUCTURE STANDARDS

CPS CONCENTRATOR WALL MOUNT 19" RACK MOUNT

NO.	DATE	REVISION	BY

DESIGNED CPS			SHEET NO.
DRAWN CPS			ED.233
CHECKED CPS	PROJECT NUMBER	SCALE NONE	DATE 08/28/08
APPROVED CPS			