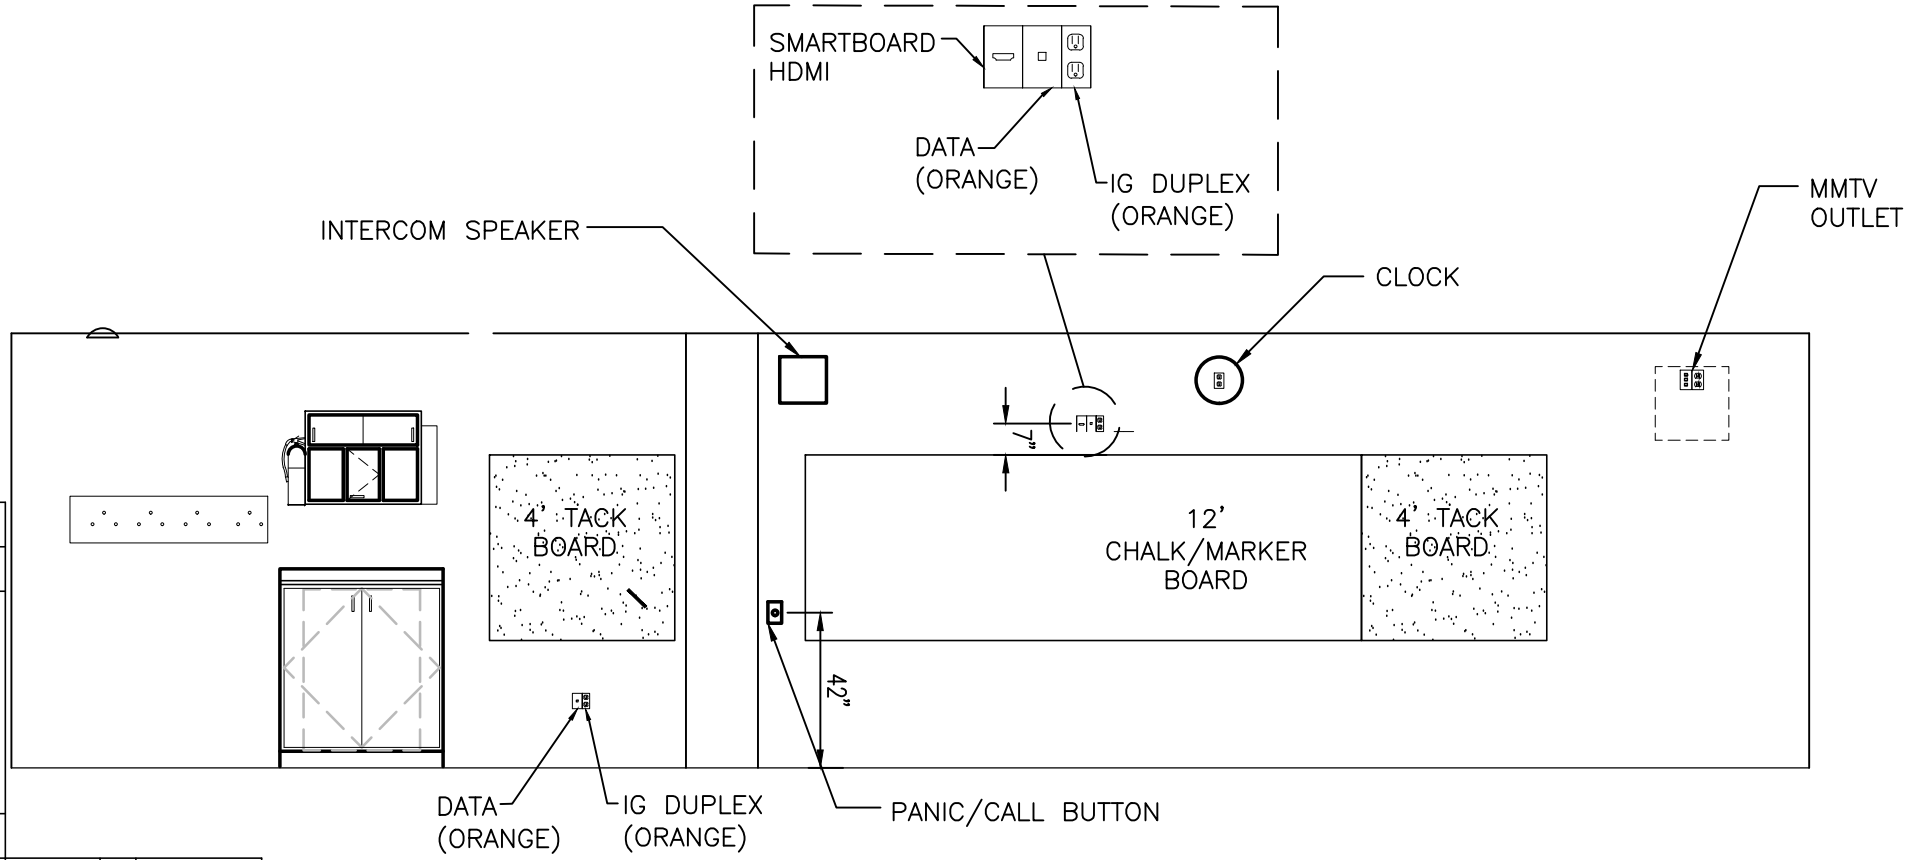

NOTES

1. FOR ALL WORKSTATION AND CLASSROOM COMPUTER STATION LOCATIONS SHOWN WITH A RECEPTACLE AND AN ASSOCIATED TELE/DATA DEVICE OR HDMI CONNECTION, PROVIDE A COMBINATION BACKBOX WITH A COMMON COVER. WALL BOX SHALL BE A TWO, THREE OR FOUR GANG BACKBOX WITH A DIVIDER, IN ORDER TO ACCOMMODATE THE POWER AND DATA. BACKBOX SHALL BE THE WALLSOURCE BACKBOX AS MANUFACTURED BY WIREMOLD OR EQUIVALENT. PROVIDE ALL NECESSARY ACCESSORIES AS REQUIRED FOR A COMPLETE INSTALLATION.

2. BACKBOXES SHALL BE OFFSET AND NOT MOUNTED BACK TO BACK.

NO.	DATE	REVISION	BY

Chicago Public Schools

CHICAGO PUBLIC SCHOOLS
CAPITAL IMPROVEMENT PROGRAM
INFORMATION TECHNOLOGY SERVICES
INFRASTRUCTURE STANDARDS

TYPICAL INTERIOR ELEVATION
SCIENCE LAB

DESIGNED CPS
DRAWN CPS
CHECKED CPS
APPROVED CPS

PROJECT NUMBER
SCALE NONE
DATE 03/23/18
SHEET NO. ED.303