



EOR TO COORDINATE AND RESOLVE ANY CONFLICTS

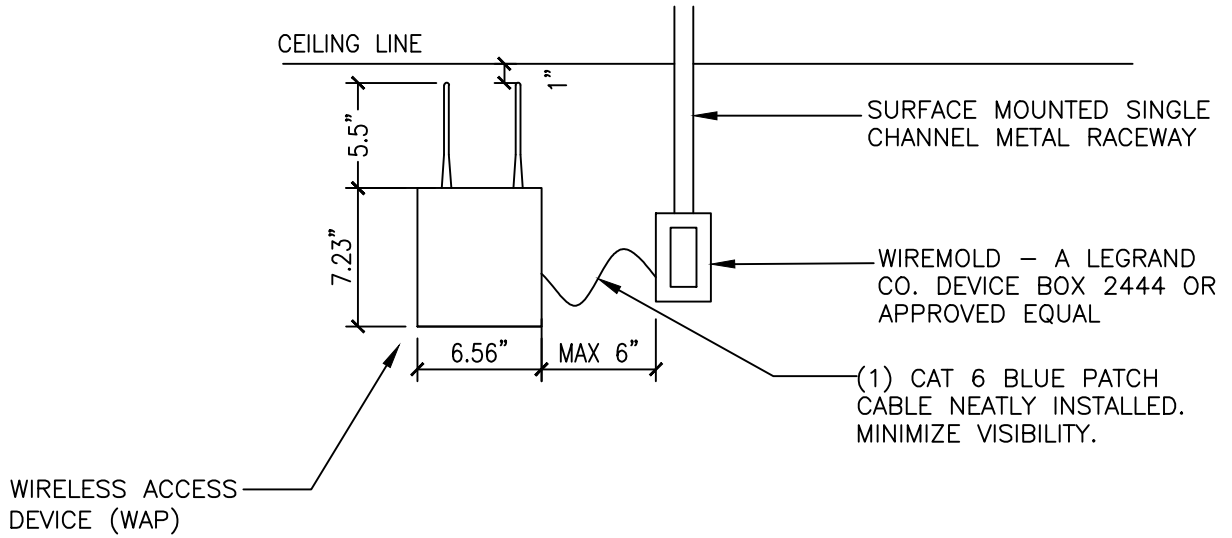

NOTE:

1. WHEN CEILING LINE IS 9'-9" OR LESS, MOUNT DEVICE BOX OR FLUSH BOX (NEW CONSTRUCTION) CENTERED AT 10-INCHES BELOW CEILING LINE.
2. WHEN CEILING LINE IS GREATER THAN 9'-9", THEN MOUNT DEVICE BOX OR FLUSH BOX (NEW CONSTRUCTION) CENTERED AT 8'-11" AFF.


**CHICAGO PUBLIC SCHOOLS**  
**CAPITAL IMPROVEMENT PROGRAM**  
**INFORMATION TECHNOLOGY SERVICES**  
**INFRASTRUCTURE STANDARDS**  
**WIRELESS ACCESS**  
**INSTALLATION DETAIL**

				DESIGNED CPS	PROJECT NUMBER	SCALE NONE	DATE 07/23/14	SHEET NO.
				DRAWN CPS				ED.861
				CHECKED CPS				
				APPROVED CPS				
NO.	DATE	REVISION	BY					